


Fitting the terminal box

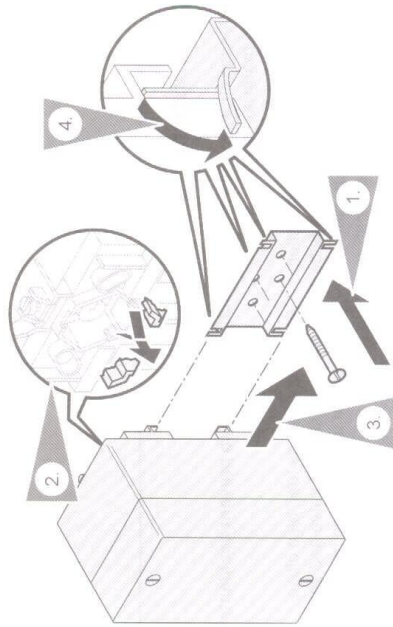


1. Secure the mounting bracket to the wall.
2. On the back of the casing, break off the knock-out webs with pliers.
3. Push the casing onto the wall mounting bracket.
4. Bend the tabs into the wall mounting bracket.

9366 0181 09

2

Electrical connections

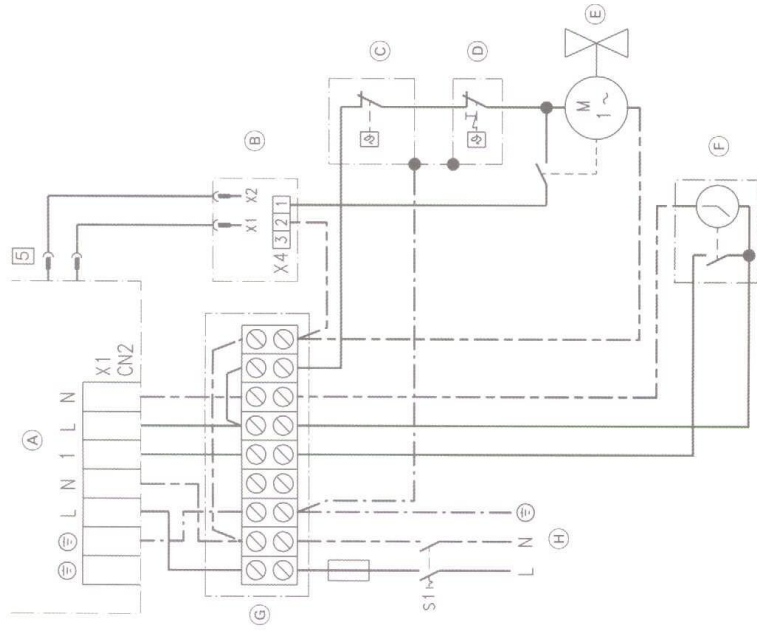

- (A) Terminals in the control unit
- (B) Cylinder demand terminal box
- (C) Cylinder thermostat
- (D) Safety temperature sensor
- (E) Valve
- (F) Room thermostat (clock thermostat)
- (G) Terminal box (on site)
- (H) Power supply 230 V, 50 Hz

1. Remove the lid from terminal box (B).

9366 0181 09

3

Cylinder demand terminal box

for the Vitodens 100-W, type WB1B

Electrical connections (cont.)

2. Make on-site wiring to X4.1 and X4.2 terminal box (B) according to the connection diagram.
Apply the strain relief to the cable.
3. Replace the lid of terminal box (B).
4. Connect the cable from terminal box (B) to plugs (5) of the cable harness inside the boiler.



Boiler installation instructions

Printed on environmentally friendly,
chlorine-free bleached paper.



Function

The heat demand issued by the cylinder thermostat is transferred via the terminal box to the boiler control unit.

Safety instructions

⚠ Please follow these safety instructions closely to prevent accidents and material losses.

Installation, initial start-up, inspection, maintenance and repairs must only be carried out by a competent person (heating engineer/installation contractor).

When using gas as fuel, also close the main gas shut-off valve and safeguard against unauthorised reopening.

Before working on the equipment/heating system, isolate the power supply (e.g. by removing a separate mains fuse or by means of a mains isolator) and safeguard against unauthorised reconnection.

Repairing components which fulfil a safety function can compromise the safe operation of your heating system.

For replacements, use only original spare parts supplied or approved by Viessmann.

Viessmann Werke GmbH & Co KG
D-35107 Allendorf
Telephone: +49 6452 70-0
Fax: +49 6452 70-2780
www.viessmann.com

Viessmann Limited
Hortonwood 30, Telford
Shropshire, TF1 7YP, GB
Telephone: +44 1952 675000
Fax: +44 1952 675040
E-mail: info-uk@viessmann.com