



Three Phase

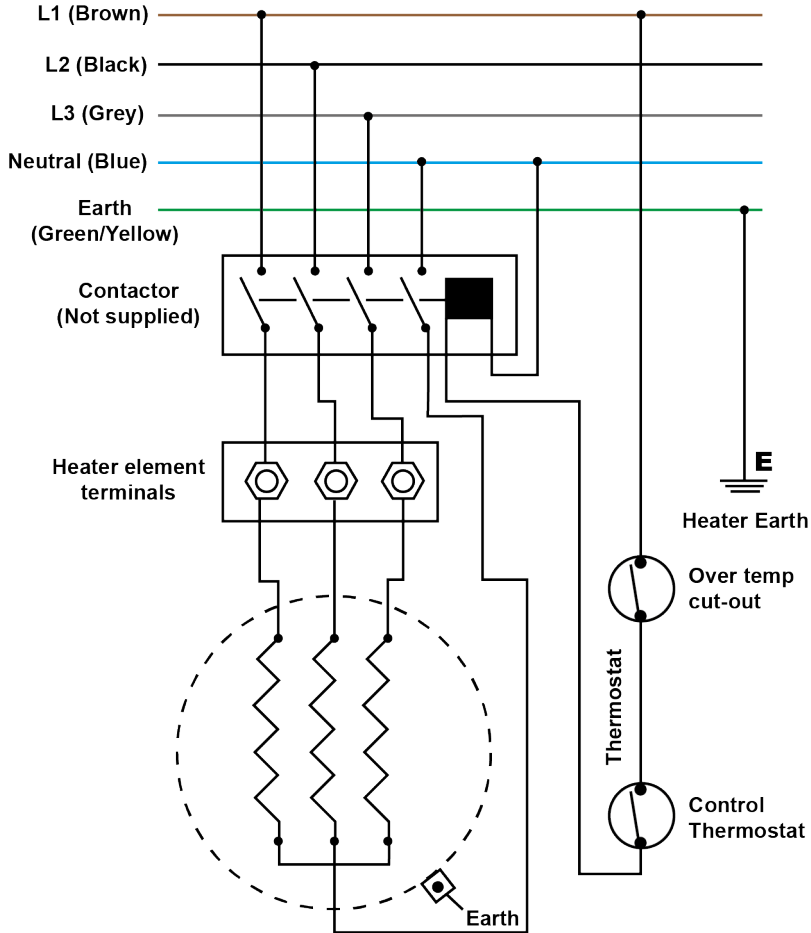

Notes:

1. All work must be carried out by suitably qualified personnel.
2. THIS HEATER MUST BE EARTHED.
3. Wire in accordance with the wiring diagram detailed above.
4. Check that the heater is compatible with the supply voltage.
5. Ensure that the supply cables are suitably rated for the heater load and that they will withstand the temperature.
6. It is the responsibility of the electrical contractor to ensure the heater and wiring conform to the regulations relating to the site.

Single Phase

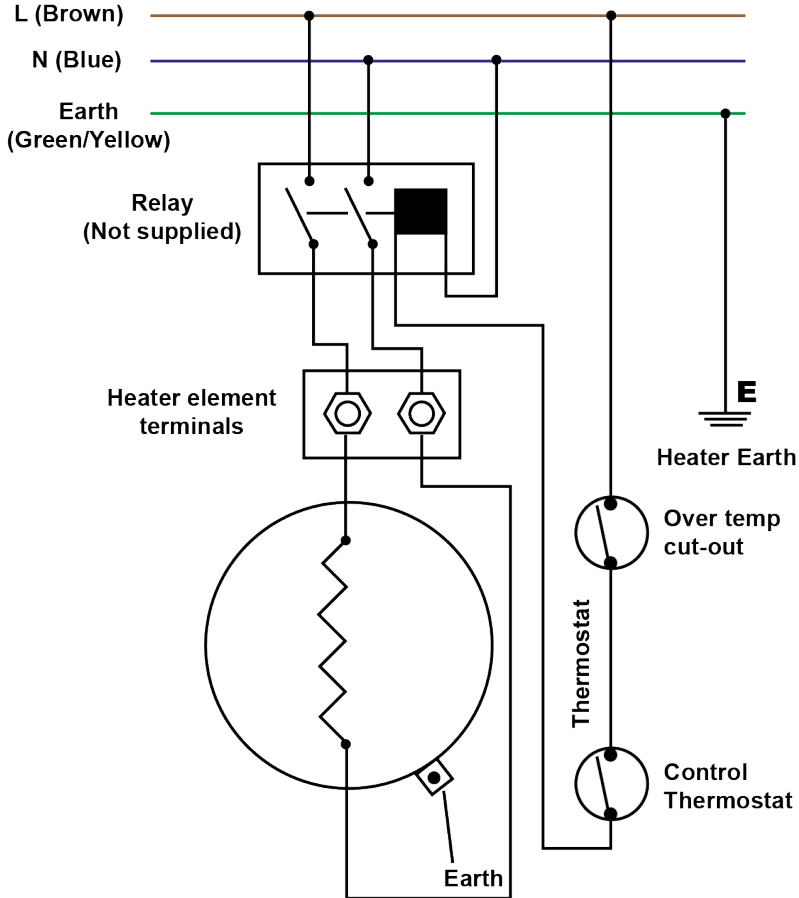

Notes:

1. All work must be carried out by suitably qualified personnel.
2. THIS HEATER MUST BE EARTHED.
3. Wire in accordance with the wiring diagram detailed above.
4. Check that the heater is compatible with the supply voltage.
5. Ensure that the supply cables are suitably rated for the heater load and that they will withstand the temperature.
6. It is the responsibility of the electrical contractor to ensure the heater and wiring conform to the regulations relating to the site.